



P2.1. Determine the deadweight of a 1-ft-long segment of the reinforced concrete beam whose cross section is shown in Figure P2.1. Beam is constructed with lightweight concrete which weighs 120 lbs/ft³.

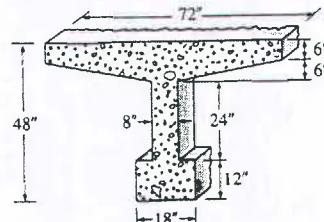

P2.1

COMPUTE THE WEIGHT/FT. OF CROSS SECTION
@ 120LB/FT³.

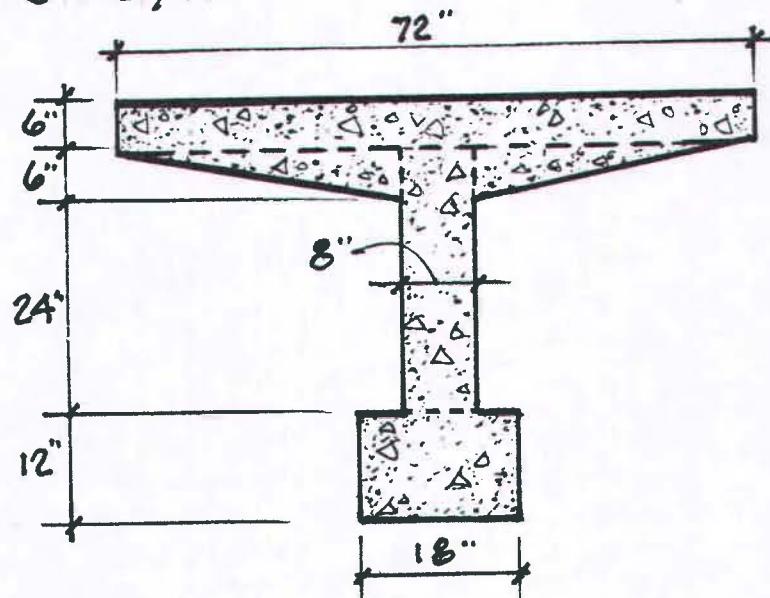


COMPUTE CROSS SECTIONAL AREA:

$$\begin{aligned} \text{AREA} &= (0.5' \times 6') + 2(1/2 \times 0.5' \times 2.67') + \\ &\quad (0.67' \times 2.5') + (1.5' \times 1') \\ &= 7.5 \text{ FT}^2 \end{aligned}$$

WEIGHT OF MEMBER PER FOOT LENGTH:


$$\text{WT/FT} = 7.5 \text{ FT}^2 \times 120 \text{ LB/FT}^3 = \underline{\underline{900 \text{ LB/FT}}}$$

P2.2. Determine the deadweight of a 1-m-long segment of the reinforced concrete girder in Figure P2.2 constructed from lightweight concrete with a unit weight of 16 kN/m³.

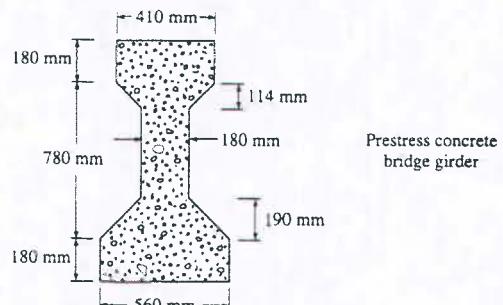

P2.2


compute the weight/m of the
cross section

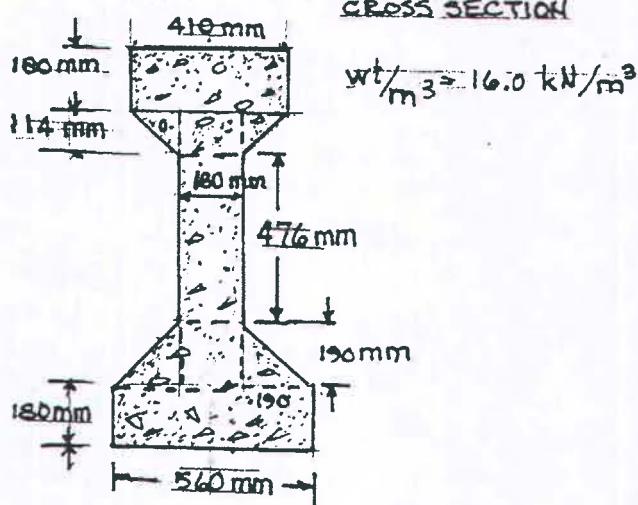


$$\begin{aligned} \text{AREA} &= (.410 \times .18) + 2 \left(\frac{.115 \times .114}{2} \right) \\ &+ .180 \times .476 + 2 \left(\frac{.190 \times .190}{2} \right) \\ &+ .560 \times .180 + (.114 + .190) \times .180 \\ &= 0.3642 \text{ m}^2 \end{aligned}$$

$$wt/m = 0.3642 \times 16 \text{ kN/m}^3 = 5.83 \frac{\text{kN}}{\text{m}}$$

P2.3. Determine the deadweight of a 1-ft-long segment of a typical 20-in-wide unit of a roof supported on a nominal 2 in × 16 in southern pine beam (the actual dimensions are $\frac{1}{2}$ in smaller). The $\frac{3}{4}$ -in plywood weighs 3 lb/ft².

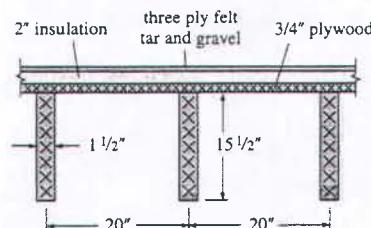

P2.3

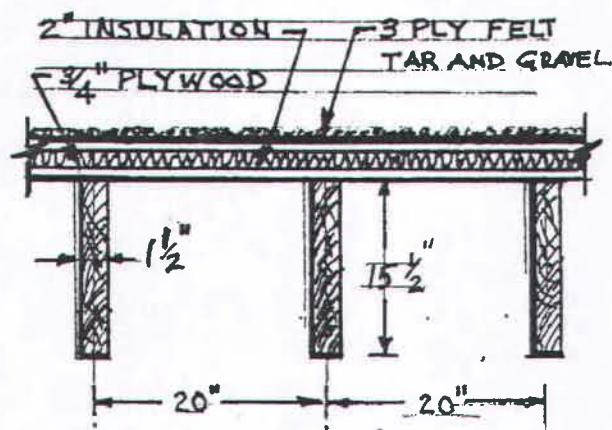

SEE TABLE 2.1 FOR WEIGHTS

wt/20" unit

$$\text{PLYWOOD: } 3 \text{ psf} \times 20 \frac{1}{2} \times 1' = 5 \text{ lb}$$


$$\text{INSULATION: } 3 \text{ psf} \times 20 \frac{1}{2} \times 1' = 5 \text{ lb}$$

$$\text{ROOF TARG: } 5.5 \text{ psf} \times 20 \frac{1}{2} \times 1' = \frac{9.17}{19.17} \text{ lb}$$

$$\text{WOOD JOIST} = 37 \text{ lb } \frac{(1.5 \times 15.5) \times 1'}{ft^3} = 5.97 \text{ lb}$$

$$\text{TOTAL WT of 20" Unit} = 19.17 + 5.97 \\ = \underline{\underline{25.14 \text{ lb Ans.}}}$$

P2.4. Consider the floor plan shown in Figure P2.4. Compute the tributary areas for (a) floor beam B1, (b) girder G1, (c) girder G2, (d) corner column C3, and (e) interior column B2.

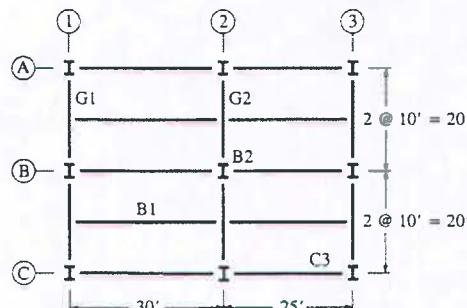


P2.4

(a) BEAM B1 SPAN 30 ft

METHOD 1: UNIFORM LOAD OVER 30'

$$A_T = 30(5+5) = \underline{300 \text{ ft}^2}$$


METHOD 2: TAPER LOADS AT ENDS

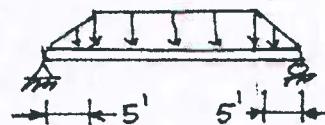

$$A_T = 300 - 4(5 \times 5 \times \frac{1}{2}) = \underline{\underline{250 \text{ ft}^2}}$$


(b) GIRDER G1 SPAN 20 ft.

METHOD 1: UNIFORM LOAD

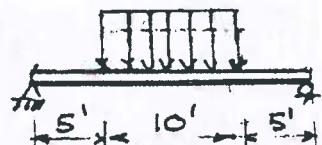

$$A_T = 10 \times 15 = \underline{\underline{150 \text{ ft}^2}}$$


METHOD 2: ADD TAPERED LOADS AT ENDS

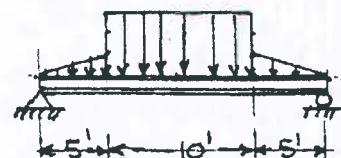

$$A_T = 150 + (5 \times 5 \times \frac{1}{2})2$$


$$A_T = \underline{\underline{175 \text{ ft}^2}}$$

COMPUTE TRIBUTARY AREAS, A_T

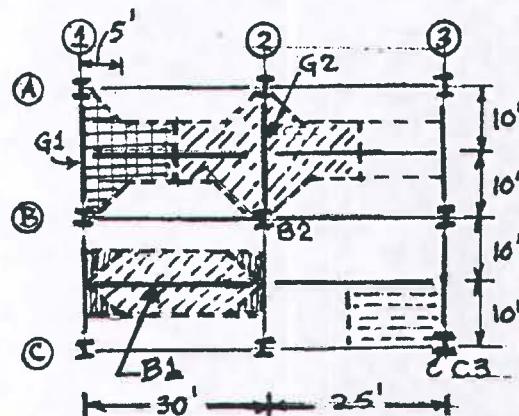


(c) GIRDER G2 SPAN 20 ft

METHOD 1: UNIFORM LOAD



$$A_T = (30\frac{1}{2} + 25\frac{1}{2})10 = \underline{\underline{275 \text{ ft}^2}}$$

METHOD 2: TAPER LOAD AT ENDS



$$A_T = 275 + 4[5 \times 5 \times \frac{1}{2}] = \underline{\underline{325 \text{ ft}^2}}$$

(d) COLUMN C3


$$A_T = 25\frac{1}{2} \times 10 = \underline{\underline{125 \text{ ft}^2}}$$

(e) COLUMN B2

$$A_T = (15 + 12.5)10 + (6)$$

$$A_T = \underline{\underline{550 \text{ ft}^2}}$$

P2.5. Refer to Figure P2.4 for the floor plan. Calculate the influence areas for (a) floor beam B1, (b) girder G1, (c) girder G2, (d) corner column C3, and (e) interior column B2.

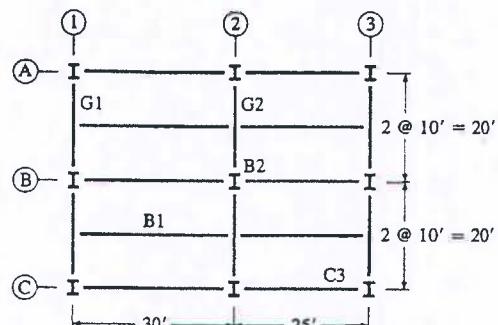

P2.4

Multiply the values of A_T in problem P2.4 by K_{LL} , where $K_{LL} = 4$ for columns and 2 for beams.

BEAM B1

METHOD 1 $K_{LL}A_T = 2(300 \text{ ft}^2) = 600 \text{ ft}^2$
METHOD 2 $K_{LL}A_T = 2(500 \text{ ft}^2) = 1000 \text{ ft}^2$

GIRDER G1

METHOD 1 $K_{LL}A_T = 2(150 \text{ ft}^2) = 300 \text{ ft}^2$
METHOD 2 $K_{LL}A_T = 2(175 \text{ ft}^2) = 350 \text{ ft}^2$


GIRDER G2

METHOD 1 $K_{LL}A_T = 2(275 \text{ ft}^2) = 550 \text{ ft}^2$
METHOD 2 $K_{LL}A_T = 2(325 \text{ ft}^2) = 650 \text{ ft}^2$

COLUMN C3 $K_{LL}A_T = 4(125 \text{ ft}^2) = 500 \text{ ft}^2$

COLUMN B2 $K_{LL}A_T = 4(550 \text{ ft}^2) = 2200 \text{ ft}^2$

P2.6. The uniformly distributed live load on the floor plan in Figure P2.4 is 60 lb/ft². Establish the loading for members (a) floor beam B1, (b) girder G1, and (c) girder G2. Consider the live load reduction if permitted by the ASCE standard.

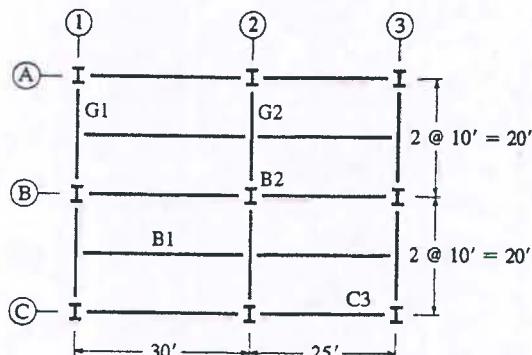

P2.4

Values of A_T are evaluated in Prob 2.4. Use simplified loading


(a) Loading for B1

$$K_{LL} A_T = 2 \times 150 = 300 > 400$$

$$t = t_0 \left(0.25 + \frac{15}{\sqrt{K_{LL} A_T}} \right)$$

$$= 60 \left(0.25 + \frac{15}{\sqrt{600}} \right) = 51.7 \text{ lb/ft}^2$$

$$\text{LIVE LOAD/ft} = \frac{51.7 \times 10}{1000} = 0.517 \text{ k/ft}$$

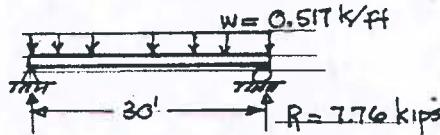


(b) LOADING for G1: supports load from a single soft beam (B1).


$$K_{LL} A_T = 2 \times 150 = 300 < 400$$

∴ NO REDUCTION ALLOWED

COMPUTE REACTION FROM BEAM B1

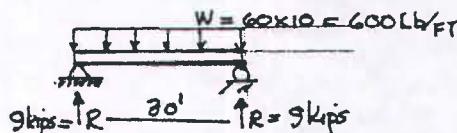

LOAD TO GIRDER G1 FROM B1





ESTABLISH LOAD FOR G2 WHICH SUPPORTS BEAMS OF 25' AND 30' AT ITS CENTER

$$K_{LL} A_T = 2 \left(10 \left[\frac{30}{2} + \frac{25}{2} \right] \right) = 550 \text{ ft}^2 > 400$$


$$t = 60 \left(0.25 + \frac{15}{\sqrt{550}} \right) = 53.4 \text{ lb/ft}^2$$

$$\text{LIVE LOAD/ft} = \frac{53.4 \times 10}{1000} = 0.534 \text{ k/ft}$$




(c) LOAD TO GIRDER G2


$$R_1 + R_2 = 14.685 \text{ kips}$$



P2.7. The elevation associated with the floor plan in Figure P2.4 is shown in Figure P2.7. Assume a live load of 60 lb/ft² on all three floors. Calculate the axial forces produced by the live load in column B2 in the third and first stories. Consider any live load reduction if permitted by the ASCE standard.

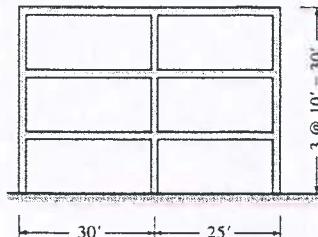


P2.7

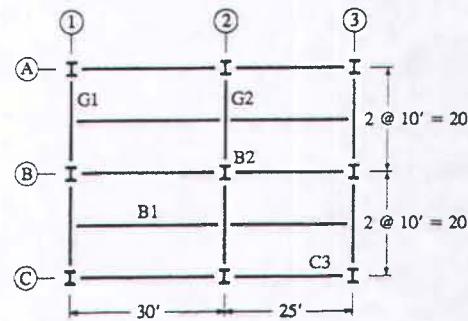

P2.4

COMPUTE THE LIVE LOAD
 FORCES IN COLUMN B2 IN
 P2.4 $w_L = 60 \text{ lb/ft}^2$

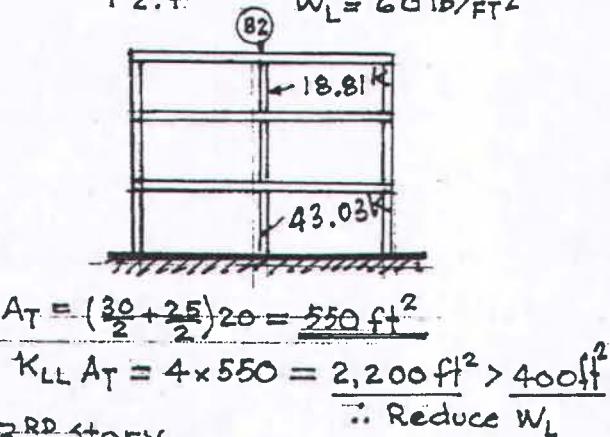

$$A_T = \left(\frac{30}{2} + \frac{25}{2} \right) 20 = 550 \text{ ft}^2$$

$$K_{LL} A_T = 4 \times 550 = 2,200 \text{ ft}^2 > 400 \text{ ft}^2$$

\therefore Reduce w_L

3RD Story

$$w = w_L \left[0.25 + \frac{15}{\sqrt{K_L A_T}} \right]$$

$$= 60 \left[0.25 + \frac{15}{\sqrt{2200}} \right] = 34.19 \text{ psf}$$

SINCE $34.19 > 0.5 w_L = 30$, USE 34.19 psf

$$P = w A_T = \frac{34.19 (550)}{1000} = 18.81 \text{ kips}$$

1ST Story

COLUMN supports 3 FLOORS

$$K_{LL} A_T = 4 (550 \times 3) = 6600 \text{ ft}^2$$

\therefore Reduce w_L


$$w = 60 \left[0.25 + \frac{15}{\sqrt{6600}} \right] = 26.08 \text{ psf}$$

SINCE $26.08 > .4 (60)$, USE 26.08 psf


$$P = w A_T = 26.08 (3 \times 550)$$

$= 43.03 \text{ kips}$

P2.8. A five-story building is shown in Figure P2.8. Following the ASCE standard, the wind pressure along the height on the windward side has been established as shown in Figure P2.8(c). (a) Considering the windward pressure in the east-west direction, use the tributary area concept to compute the resultant wind force at each floor level. (b) Compute the horizontal base shear and the overturning moment of the building.

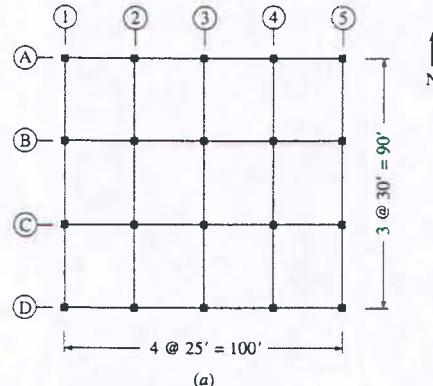

P2.8

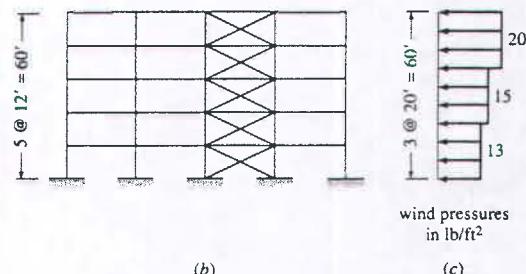


(b)

wind pressures
in lb/ft^2

(c)

P2.8

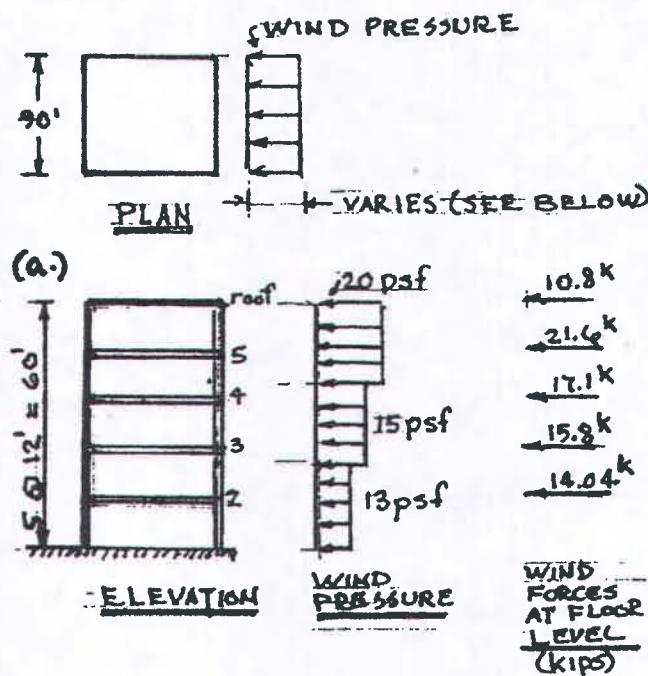

a) Resultant Wind Forces

$$\text{Roof} \quad 20 \text{ psf} (6 \times 90) = 10,800 \text{ lb}$$

$$\text{1st floor} \quad 20 \text{ psf} (12 \times 90) = 21,600 \text{ lb}$$

$$\text{2nd floor} \quad 20 \text{ psf} (2 \times 90) + 15(10 \times 90) = 17,100 \text{ lb}$$

$$\text{3rd floor} \quad 15 \text{ psf} (10 \times 90) + 13(2 \times 90) = 15,800 \text{ lb}$$

$$\text{4th floor} \quad 13 \text{ psf} (12 \times 90) = 14,040 \text{ lb}$$


$$\text{b) HORIZONTAL BASE SHEAR } V_{\text{BASE}} = \sum \text{FORCES AT EACH LEVEL} = \\ 10.8k + 21.6k + 17.1k + 15.8k + 14.04k = \\ V_{\text{BASE}} = 79.34k$$

$$\text{OVERTURNING MOMENT OF THE BUILDING} = \sum (\text{FORCE @ A. LEVEL} \times \text{HEIGHT ABOVE BASE})$$

$$10.8k (60') + 21.6(48') + 17.1(36') + 15.8k(24') + 14.04k(12') =$$

$$\text{MOVERTURNING} = 2,848 \text{ ft-k}$$

P2.9. The dimensions of a 9-m-high warehouse are shown in Figure P2.9. The windward and leeward wind pressure profiles in the long direction of the warehouse are also shown. Establish the wind forces based on the following information: basic wind speed = 40 m/s, wind exposure category = C, $K_d = 0.85$, $K_{st} = 1.0$, $G = 0.85$, and $C_p = 0.8$ for windward wall and -0.2 for leeward wall. Use the K_z values listed in Table 2.4. What is the total wind force acting in the long direction of the warehouse?

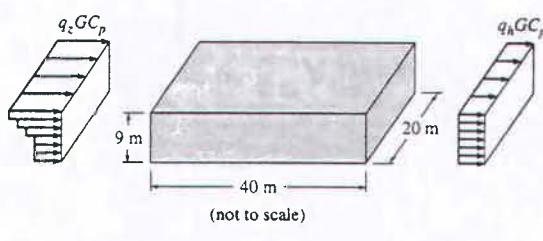

P2.9

$$\text{USE } I=1 \\ q_s = 0.613 V^2 \quad (\text{Eq 2.4b}) \\ = 0.613(40)^2 = 980.8 \text{ N/m}^2$$

$$q_z = q_s I K_z K_{st} K_d \\ q_z = 980.8(1)K_z(1)(0.85) = 833.7 K_z$$

$$0-4.6 \text{ m: } q_z = 833.7(0.85) = 708.6 \text{ N/m}^2 \\ 4.6-6.1 \text{ m: } q_z = 833.7(0.90) = 750.3 \text{ N/m}^2 \\ 6.1-7.6 \text{ m: } q_z = 833.7(0.94) = 783.7 \text{ N/m}^2 \\ 7.6-9 \text{ m: } q_z = 833.7(0.98) = 817.1 \text{ N/m}^2$$

FOR THE WINDWARD WALL

$$p = q_z G C_p \quad (\text{Eq 2.7}) \\ \text{where } G C_p = 0.85(0.8) = 0.68$$

$$p = 0.68 q_z$$

$$0-4.6 \text{ m } p = 481.8 \text{ N/m}^2$$

$$4.6-6.1 \text{ m } p = 510.2 \text{ N/m}^2$$

$$6.1-7.6 \text{ m } p = 532.9 \text{ N/m}^2$$

$$7.6-9 \text{ m } p = 555.6 \text{ N/m}^2$$

TOTAL WIND FORCE, F_w , WINDWARD WALL

$$F_w = 481.8[4.6 \times 20] + 510.2[1.5 \times 20]$$

$$+ 532.9[1.5 \times 20] + 555.6[1.4 \times 20]$$

$$F_w = 91,180 \text{ N}$$

FOR LEEWARD WALL

$$p = q_h G C_p = q_h (0.85)(-0.2) \\ q_h = q_z \text{ at } 9 \text{ m} = 817.1 \text{ N/m}^2 \text{ (above)}$$

$$p = 817.1 (0.85)(-0.2) = -138.9 \text{ N/m}^2$$

TOTAL WIND FORCE, F_L , ON LEEWARD WALL

$$F_L = (20 \times 9)(-138.9) = -25,003 \text{ N}^*$$

$$\begin{aligned} \text{TOTAL FORCE} &= F_w + F_L \\ &= 91,180 \text{ N} + 25,003 \\ &= 116,183.3 \text{ N} \end{aligned}$$

* BOTH F_w AND F_L ACT IN SAME DIRECTION.

P2.10. The dimensions of a gabled building are shown in Figure P2.10a. The external pressures for the wind load perpendicular to the ridge of the building are shown in Figure P2.10b. Note that the wind pressure can act toward or away from the windward roof surface. For the particular building dimensions given, the C_p value for the roof based on the ASCE standard can be determined from Table P2.10, where plus and minus signs signify pressures acting toward and away from the surfaces, respectively. Where two values of C_p are listed, this indicates that the windward roof slope is subjected to either


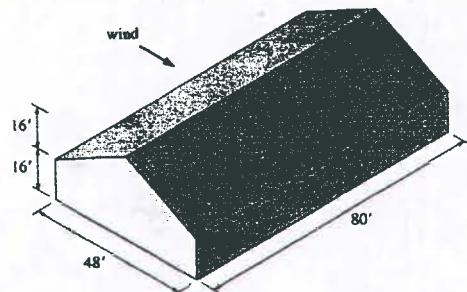


TABLE P2.10

Roof Pressure Coefficient C_p


positive or negative pressures, and the roof structure should be designed for both loading conditions. The ASCE standard permits linear interpolation for the value of the inclined angle of roof θ . But interpolation should only be carried out between values of the same sign. Establish the wind pressures on the building when positive pressure acts on the windward roof. Use the following data: basic wind speed = 100 mi/h, wind exposure category = B, $K_d = 0.85$, $K_z = 1.0$, $G = 0.85$, and $C_p = 0.8$ for windward wall and -0.2 for leeward wall.

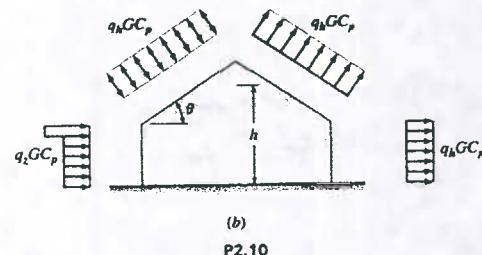

(b)

P2.10

Angle θ	Windward						θ defined in Fig. P2.10	Leeward				
	10	15	20	25	30	35		45	≥ 60	10	15	≥ 20
C_p	-0.9	-0.7	-0.4	-0.3	-0.2	-0.2	0.0	0.0	0.01θ*	-0.5	-0.5	-0.6
			0.0	0.2	0.2	0.3		0.4				

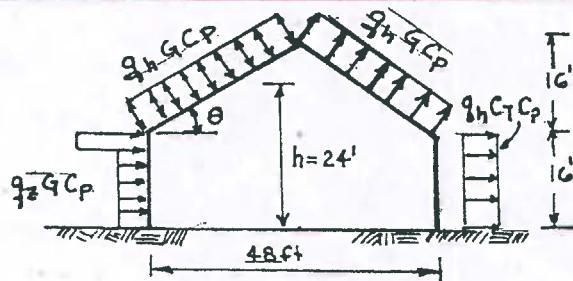

MEAN ROOF HEIGHT, $h = 24$ ft
 $\theta = \tan^{-1} \left(\frac{16}{24} \right) = 33.69^\circ$ (for Table 2.10)

CONSIDER POSITIVE WINDWARD PRESSURE ON ROOF, i.e. left side.

INTERPOLATE IN TABLE P2.10

$$C_p = 0.2 + \frac{(33.69 - 30)}{(35 - 30)} \times 0.1 \\ C_p = 0.2738 \quad (\text{Roof only})$$

FROM TABLE 2.4 (SEE p48 OF TEXT)

$$K_z = 0.57, \quad 0-15^\circ \\ = 0.62, \quad 15'-20^\circ \\ = 0.66, \quad 20'-25^\circ \\ = 0.70, \quad 25'-30^\circ \\ = 0.76, \quad 30'-32^\circ$$

$$K_{zt} = 1.0, K_d = 0.85, I = 1$$

$$q_s = 0.00256 V^2 \quad (\text{Eq 2.4a}) \\ q_s = 0.00256 (100)^2 = 25.6 \text{ lb/ft}^2$$

$$q_z = q_s I K_z K_{zt} K_d \\ 0-15^\circ; q_z = 2.56 (1)(0.57)(1)(0.85) \\ = 12.40 \text{ lb/ft}^2$$

$$15-16^\circ; q_z = 13.49 \text{ lb/ft}^2 \\ h = 24'; q_z = 14.36 \text{ lb/ft}^2$$

WIND PRESSURE ON WINDWARD WALL & ROOF

$$P = q_z G C_p \\ \text{WALL, } 0-15^\circ; P = 12.40 \times 0.85 \times 0.80 \\ P = 8.43 \text{ psf}$$

$$\text{WALL, } 15-16^\circ; P = 13.49 \times 0.85 \times 0.8 = 9.17 \text{ psf}$$

$$\text{Roof, } P = 14.36 \times 0.85 \times 0.2738 \\ P = 3.34 \text{ psf} \downarrow$$


WIND PRESSURE ON LEEWARD SIDE

$$\text{FOR WALL } P = q_b G C_p$$


$$\text{FOR } h = 24'; q_b = q_z = 14.36 \text{ lb/ft}^2 \\ C_p = -0.2 \text{ FOR WALL } = 0.6 \text{ FOR ROOF} \\ \text{FOR WALL } P = 14.36 (0.85)(-0.2) \\ P = -2.44 \text{ lb/ft}^2$$

$$\text{FOR ROOF } P = 14.36 (0.85)(-0.6) \\ = -7.32 \text{ lb/ft}^2 \text{ (uplift)}$$

P2.11. Establish the wind pressures on the building in Problem P2.10 when the windward roof is subjected to an uplift wind force.

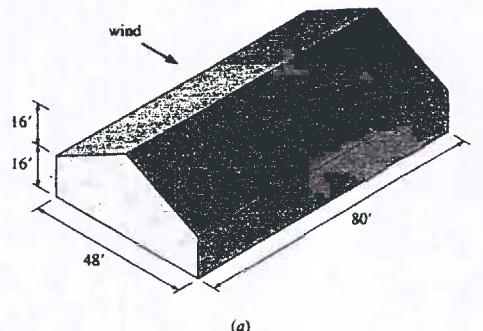

(a)

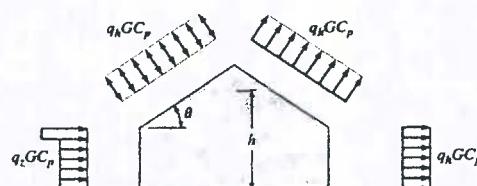

(b)

P2.10

TABLE P2.10

Roof Pressure Coefficient C_p

* θ defined in Fig. P2.10

Angle θ	Windward							Leeward			
	10	15	20	25	30	35	45	≥ 60	10	15	≥ 20
C_p	-0.9	-0.7	-0.4	-0.3	-0.2	-0.2	0.0	0.010*	-0.5	-0.5	-0.6
				0.0	0.2	0.2	0.3	0.4			

SEE SEE P2.10 SOLUTION
WINDWARD ROOF (NEGATIVE PRESSURE)

$$\theta = 33.7^\circ$$


Interpolate between 30° and 35°
 for negative C_p value in Table P2.10

$$C_p = -0.274$$

$$P = q_h G C_p = 21.76 (0.64) 0.85 (-0.274) \\ = -3.34 \text{ lb/ft}^2 (\text{SUCTION})$$

NOTE: Wind pressures on other
 3 surfaces are the same as in
 P2.10

P2.12. (a) Determine the wind pressure distribution on the four sides of the 10-story hospital shown in Figure P2.12. The building is located near the Georgia coast where the wind velocity contour map in Figure 2.15 of the text specifies a design wind speed of 140 mph. The building, located on level flat ground, is classified as *stiff* because its natural period is less than 1 s. On the windward side, evaluate the magnitude of the wind pressure every 35 ft in the vertical direction. (b) Assuming the wind pressure on the windward side varies linearly between the 35-ft intervals, determine the total wind force on the building in the direction of the wind. Include the negative pressure on the leeward side.

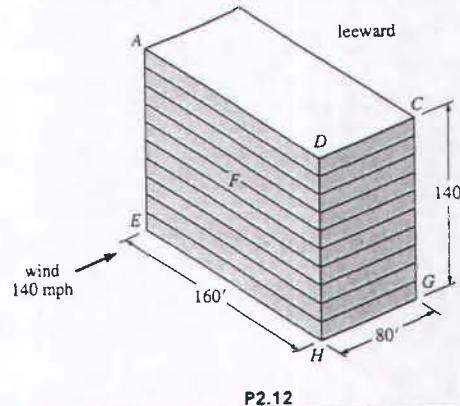

P2.12

(a.) COMPUTE VARIATION OF WIND PRESSURE ON WINDWARD FACE

$$q_{z2} = q_s K_z K_{zt} K_d \quad \text{EQ 2.6}$$

$$q_s = 0.00256 V^2 \quad \text{EQ 2.4a}$$

$$= 0.00256(140)^2$$

$$q_s = 50.18 \text{ psf; Round to } 50.18 \text{ psf}$$

$I = 1.15$ for hospitals

$$K_{zt} = 1; K_d = 0.85$$

K_z , READ IN TABLE 2.4

ELEV. (ft)	0	35'	70'	105	140
K_z	1.03	1.19	1.34	1.44	1.52

$$q_{z2} = 50.18(1.15)(K_z) 1(0.85)$$

$$q_{z2} = 49.05 K_z$$

COMPUTE WIND PRESSURE p ON WINDWARD FACE

$$p = q_{z2} G C_p = 49.05 K_z G C_p$$

where $G = 0.85$ for natural period less than 1 SEC.

$C_p = 0.8$ on windward side

$$p = 49.05 K_z (0.85)(0.8) = 33.354 K_z$$

Compute p for various elevations

ELEV. (ft)	0	35'	70'	105	140
p (psf)	34.36	39.69	44.69	48.03	50.70

COMPUTE WIND PRESSURE ON LEEWARD WALL

$$p = q_{z2} G C_p; \text{ Use VALUE OF } q_{z2} \text{ AT } 140 \text{ FT. i.e. } K_z = 1.52$$

$$C_p = -0.5 \quad q_{z2} = 49.05(1.52) = 74.556$$

$$p = 74.556 G C_p = 74.556(0.85)(-0.5)$$


$$p = -31.68 \text{ psf. ANS.}$$

WIND PRESSURE ON SIDE WALLS

$$p = q_s G C_p \approx 49.05(1.5)(0.85)(-0.7)$$

$$p = -44.36 \text{ psf}$$

(b.) VARIATION OF WIND PRESSURE ON WINDWARD AND LEEWARD SIDES

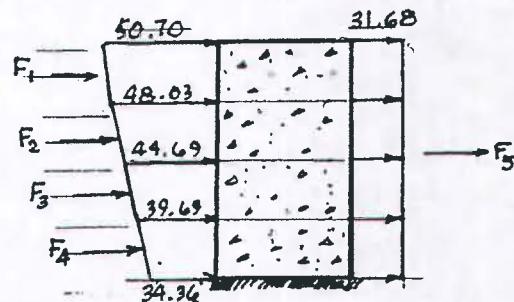

WIND PRESSURES (psf)

COMPUTE TOTAL WIND FORCE (kips)

$$F_1 = \frac{50.7 + 48.03}{2} \frac{[35 \times 60]}{1000} = 276.42 \text{ kips}$$

$$F_2 = \frac{48.03 + 44.69}{2} \frac{[35 \times 160]}{1000} = 259.62 \text{ kips}$$


$$F_3 = \frac{44.69 + 39.69}{2} \frac{[35 \times 160]}{1000} = 236.26 \text{ kips}$$

$$F_4 = \frac{39.69 + 34.36}{2} \frac{[35 \times 160]}{1000} = 207.34 \text{ kips}$$

$$F_5 = \frac{31.68(140 \times 160)}{1000} = 709.63 \text{ kips}$$


$$\begin{aligned} \text{TOTAL WIND FORCE} &= \sum F_1 + F_2 + F_3 + F_4 + F_5 \\ &= 1689.27 \text{ kips} \end{aligned}$$

P2.13. Consider the five-story building shown in Figure P2.8. The average weights of the floor and roof are 90 lb/ft^2 and 70 lb/ft^2 , respectively. The values of S_{D1} and S_{D2} are equal to $0.9g$ and $0.4g$, respectively. Since steel moment frames are used in the north-south direction to resist the seismic forces, the value of R equals 8. Compute the seismic base shear V . Then distribute the base shear along the height of the building.

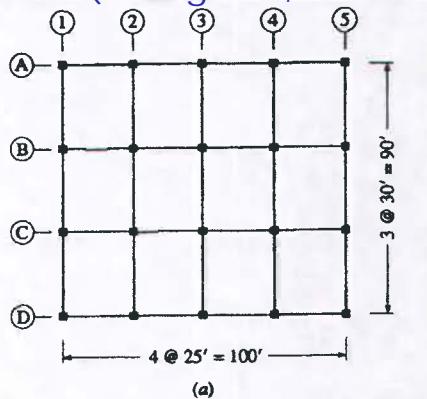

(a)

P2.8

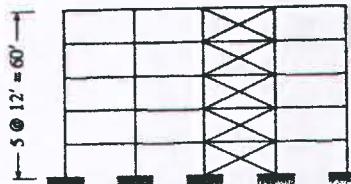

(b)



(c)

P2.8

$$\begin{array}{ll} \text{FUNDAMENTAL PERIOD} & \\ T = C_f h_n^{3/4} & f_4 = 0.035 \text{ for} \\ T = 0.035(60)^{3/4} & \text{steel moment} \\ T = 0.75 \text{ SEC.} & \text{frames} \end{array}$$

$$W = 4(100 \times 90) 90 \text{ lb/ft}^2 + (100 \times 90) 70 \text{ lb/ft}^2 = 3,870,000 \text{ lbs} = 3,870 \text{ kips}$$

$$V = \frac{S_{D1} W}{T(R/I)} \quad I = 1 \text{ for office bldgs.}$$

$$V = \frac{0.4(3870)}{0.75(8/1)} = 258 \text{ kips}$$

$$V_{\max} = \frac{S_{D2} W}{R/I} = \frac{0.9(3870)}{8/1} = 435 \text{ kips}$$

$$V_{\min} = 0.0441 \cdot I \cdot S_{D2} W \\ = 0.0441(1)(0.9)(3870) \\ = 153.6 \text{ kips}$$

THEREFORE. USE $V = 258 \text{ kips}$


$$k = 1 + \frac{T - 0.5}{2} = 1.125$$

$$F_x = \frac{W_i h_i^k}{\sum_{i=1}^n W_i h_i^k} V$$

FORCES AT EACH FLOOR LEVEL

FLOOR	WEIGHT W_i (kips)	FLOOR HEIGHT h_i (ft)	$W_i h_i^k$	$\frac{W_i h_i^k}{\sum W_i h_i^k}$	F_x (kips)
Roof	6.30	60	63,061	0.295	76.1
5th	8.10	48	63,079	0.295	76.1
4th	8.10	36	45,638	0.213	56.0
3rd	8.10	24	28,922	0.135	34.8
2nd	8.10	12	13,261	0.062	16.0
$\Sigma = 3,870$			$\Sigma = 213,961$		$\Sigma = 258$

P2.14. (a) A two-story hospital facility shown in Figure P2.14 is being designed in New York with a basic wind speed of 90 mi/h and wind exposure D. The importance factor I is 1.15 and $K_z = 1.0$. Use the simplified procedure to determine the design wind load, base shear, and building overturning moment. (b) Use the equivalent lateral force procedure to determine the seismic base shear and overturning moment. The facility, with an average weight of 90 lb/ft² for both the floor and roof, is to be designed for the following seismic factors: $S_{D5} = 0.27g$ and $S_{D1} = 0.06g$; reinforced concrete frames with an R value of 8 are to be used. The importance factor I is 1.5. (c) Do wind forces or seismic forces govern the strength design of the building?

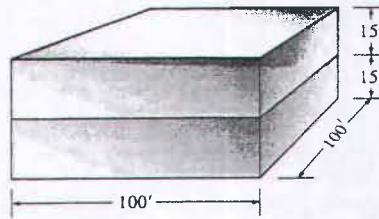

P2.14

(a) WIND LOADS USING SIMPLIFIED PROCEDURE:

$$\text{DESIGN WIND PRESSURE } P_s = \lambda K_{st} I P_{s30}$$

$$\lambda = 1.66 \text{ TABLE 2.8, MEAN ROOF HEIGHT} = 30'$$

ZONES	P_{s30}	$P_s = 1.66(1)1.15P_{s30} = 1.909 P_{s30}$
A	12.8 psf	24.44 psf
C	8.5 psf	16.22 psf

RESULTANT FORCE AT EACH LEVEL; WHERE
DISTANCE $a = 0.1(100') = 10'$; $0.4(30') = 12'$; $3'$

$$a = 10' \text{ CONTROLS } \frac{1}{2} 2a = 20' \text{ REGION A}$$

$$\text{FROOF: ZONE A : } \frac{15'}{2}(24.44 \text{ psf}) 20'/1000 = 3.67 \text{ k}$$

$$\text{ZONE C : } \frac{15'}{2}(16.22 \text{ psf}) 80'/1000 = 9.78 \text{ k}$$

$$\text{FROOF RESULTANT} = 13.45 \text{ k}$$

$$\text{F}_2^{\text{ND}}: \text{ZONE A : } 15'(24.44 \text{ psf}) 20'/1000 = 7.33 \text{ k}$$


$$\text{ZONE C : } 15'(16.22 \text{ psf}) 80'/1000 = 19.56 \text{ k}$$

$$\text{F}_2^{\text{ND}} \text{ RESULTANT} = 26.89 \text{ k}$$

$$\text{BASE SHEAR } V_{\text{BASE}} = \text{FROOF} + \text{F}_2^{\text{ND}} = 40.34 \text{ k}$$

$$\text{OVERTURNING MOMENT } M_{\text{O.T.}} = \sum F_i h_i$$

$$M_{\text{O.T.}} = 13.45 \text{ k}(30') + 26.89 \text{ k}(15') = 804.9 \text{ ft-k}$$

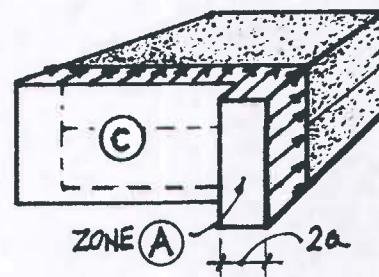

P2.14 CONTINUED

P2.14 CONTINUED

(b) SEISMIC LOADS BY EQUIVALENT LATERAL FORCE PROCEDURE

GIVEN: $w = 90 \text{ psf}$ FLOOR & ROOF; $S_{D3} = 0.27g$, $S_D = 0.06g$; $R=8$, $I=1.5$

$$\text{BASE SHEAR } V_{\text{BASE}} = \frac{S_D w}{T(R/I)}$$

WHERE w TOTAL BUILDING DEAD LOAD =

$$W_{\text{ROOF}} = 90 \text{ psf} (100')^2 = 900k$$

$$W_{2\text{ND}} = 90 \text{ psf} (100')^2 = 900k$$

$$W_{\text{TOTAL}} = 1800k$$

AND $T = C_T h_n^x = 0.342 \text{ sec.}$

$C_T = 0.016$ REINF. CONCRETE FRAME

$x = 0.9$ " " "

$h = 30'$ BUILDING HEIGHT

$$V_{\text{BASE}} = \frac{0.06 (1800k)}{(0.342 \text{ sec})(8/1.5)} = 0.033 \frac{w}{T} = 59.2k \quad \text{CONTROLS 3}$$

$$V_{\text{MAX.}} = \frac{S_{D3} w}{R/I} = \frac{0.27 (1800k)}{(8/1.5)} = 0.051 \frac{w}{T} = 91.1k$$

$$V_{\text{MIN.}} = 0.044 S_D I w = 0.044 (0.27)(1.5)(1800k) \\ = 0.0178 w = 32.1k$$

FORCE @ EACH LEVEL $F_x = \frac{w_i h_i k}{\sum w_i h_i k} V_{\text{BASE}}$, WHERE $V_{\text{BASE}} = 59.2k$
 $T < 0.5 \text{ SEC.}$ THUS $k = 1.0$

LEVEL	w_i	h_i	$w_i h_i k$	$w_i h_i k / \sum w_i h_i k$	FORCE @ EA. LEVEL:
ROOF	900k	30'	27000	0.667	$F_{\text{ROOF}} = 39.5k$
2ND	900k	15'	13500	0.333	$F_{2\text{ND}} = 19.76k$
$\sum w_i h_i k = 40500$				$\sum F_x = V_{\text{BASE}} = 59.2k$	

OVERTURNING MOMENT $M_{\text{O.T.}} = \sum F_x h_i$

$$M_{\text{O.T.}} = 39.5k(30') + 19.76k(15') = 1,481.4 \text{ FT}\cdot\text{k}$$

(c) SEISMIC FORCES GOVERN THE LATERAL STRENGTH DESIGN.

P2.15. When a moment frame does not exceed 12 stories in height and the story height is at least 10 ft, the ASCE standard provides a simpler expression to compute the approximate fundamental period:

$$T = 0.1N$$

where N = number of stories. Recompute T with the above expression and compare it with that obtained from Problem P2.13. Which method produces a larger seismic base shear?

ASCE APPROXIMATE FUNDAMENTAL PERIOD:

$$T = 0.1N$$

$$N = 5 \therefore T = 0.5 \text{ seconds}$$

$$V = \frac{0.3 \times 6750}{0.5 (5/1)} = 810 \text{ kips}$$

THE SIMPLER APPROXIMATE METHOD PRODUCES A LARGER VALUE OF BASE SHEAR.